



**Technical and Test Institute
for Construction Prague**
Prosecká 811/76a
190 00 Prague
Czech Republic
eota@tzus.cz



European Technical Assessment

**ETA 17/0659
of 17/07/2019**

**Technical Assessment Body issuing the
ETA:**

Technical and Test Institute
for Construction Prague

Trade name of the construction product

MOPUR3

**Product family to which the construction
product belongs**

Product area code: 33
Bonded injection type anchor for use in
cracked and uncracked concrete

Manufacturer

Index Técnicas Expansivas, S.L.
P.I. La Portalada II C. Segador 13
26006 Logroño
Spain

Manufacturing plant

Index plant 1

**This European Technical Assessment
contains**

21 pages including 17 Annexes which form
an integral part of this assessment.

**This European Technical Assessment is
issued in accordance with regulation
(EU) No 305/2011, on the basis of**

EAD 330499-01-0601

This version replaces

ETA 17/0659 issued on 11/11/2018

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body - Technical and Test Institute for Construction Prague. Any partial reproduction has to be identified as such.

1. Technical description of the product

The MOPUR3 with steel elements is bonded anchor (injection type).

Steel elements can be galvanized or stainless steel threaded rods or rebars.

Steel element is placed into a drilled hole filled with injection mortar. The steel element is anchored via the bond between metal part, injection mortar and concrete. The anchor is intended to be used with various embedment depth up to 20 diameters. The illustration and the description of the product are given in Annex A.

2. Specification of the intended use in accordance with the applicable EAD

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the products in relation to the expected economically reasonable working life of the works.

3. Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|--|-------------------------|
| Static and quasi-static loading | |
| Resistance to steel failure (tension) | See Annex C 1, C 2 |
| Resistance to combined pull-out and concrete failure | See Annex C 1, C 2 |
| Resistance to concrete cone failure | See Annex C 1, C 2 |
| Edge distance to prevent splitting under load | See Annex C 1, C 2 |
| Robustness | See Annex C 1, C 2 |
| Maximum setting torque moment | See Annex B 5 |
| Minimum edge distance and spacing | See Annex B 5 |
| Resistance to steel failure (shear) | See Annex C 3, C 4 |
| Resistance to pry-out failure | See Annex C 3, C 4 |
| Resistance to concrete edge failure | See Annex C 3, C 4 |
| Displacements under short term and long term loading | See Annex C 5 |
| Durability of metal parts | See Annex A 3 |
| Seismic performance C1 and C2 | |
| Resistance to steel failure | See Annex C 6, C 7, C 8 |
| Resistance to pull-out | See Annex C 6, C 7, C 8 |
| Factor for annular gap | See Annex C 6, C 7, C 8 |
| Displacement | See Annex C 8 |

3.2 Hygiene, health and environment (BWR 3)

No performance determined.

3.3 General aspects relating to fitness for use

Durability and serviceability are only ensured if the specifications of intended use according to Annex B 1 are kept.

4. Assessment and verification of constancy of performance (AVCP) system applied with reference to its legal base

According to the Decision 96/582/EC of the European Commission¹ the system of assessment verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table apply.

¹ Official Journal of the European Communities L 254 of 08.10.1996

| Product | Intended use | Level or class | System |
|-----------------------------------|--|-----------------------|---------------|
| Metal anchors for use in concrete | For fixing and/or supporting to concrete, structural elements (which contributes to the stability of the works) or heavy units | - | 1 |

5. Technical details necessary for the implementation of the AVCP system, as provided in the applicable EAD

5.1 Tasks of the manufacturer

The manufacturer may only use raw materials stated in the technical documentation of this European Technical Assessment.

The factory production control shall be in accordance with the control plan which is a part of the technical documentation of this European Technical Assessment. The control plan is laid down in the context of the factory production control system operated by the manufacturer and deposited at Technický a zkušební ústav stavební Praha, s.p.² The results of factory production control shall be recorded and evaluated in accordance with the provisions of the control plan.

5.2 Tasks of the notified bodies

The notified body shall retain the essential points of its actions referred to above and state the results obtained and conclusions drawn in a written report.

The notified certification body involved by the manufacturer shall issue a certificate of constancy of performance of the product stating the conformity with the provisions of this European Technical Assessment.

In cases where the provisions of the European Technical Assessment and its control plan are no longer fulfilled the notified body shall withdraw the certificate of constancy of performance and inform Technický a zkušební ústav stavební Praha, s.p without delay.

Issued in Prague on 17.07.2019


By

Ing. Mária Schaan


Head of the Technical Assessment Body

² The control plan is a confidential part of the documentation of the European Technical Assessment, but not published together with the ETA and only handed over to the approved body involved in the procedure of AVCP.

Threaded rod

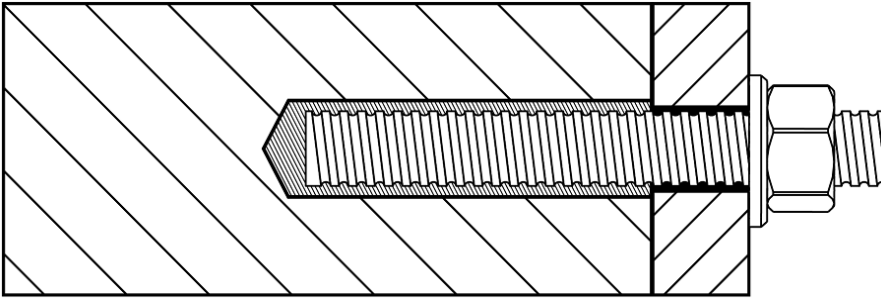

Reinforcing bar

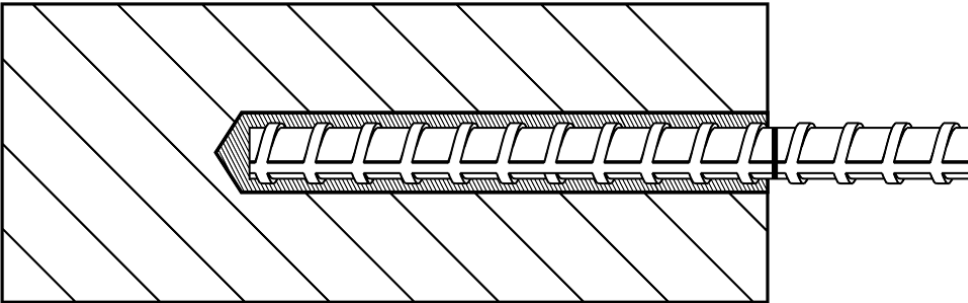

MOPUR3

Product description
Installed conditions


Annex A 1

Mortar cartridges

Side by side cartridge

MOPUR33


385 ml
585 ml

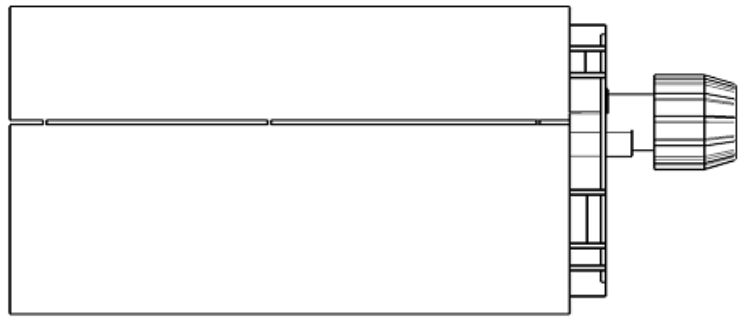

Two part foil capsule within in a single component cartridge (FCC)

MOPUR33

300 ml

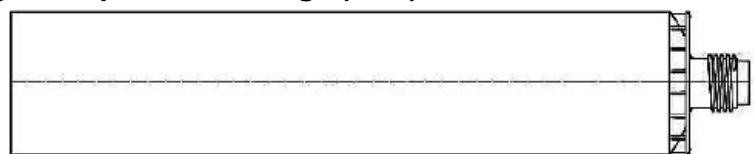


Marking of the mortar cartridges


Identifying mark of the producer, Trade name, Charge code number, Storage life, Curing and processing time

Mixing nozzle

Q



QH

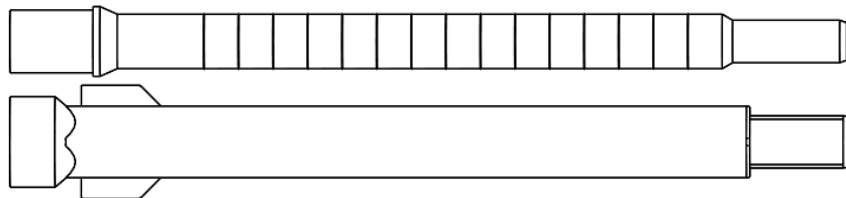

QR




MOPUR3

Product description
Injection system

Annex A 2

Threaded rod M8, M10, M12, M16, M20, M24, M27, M30

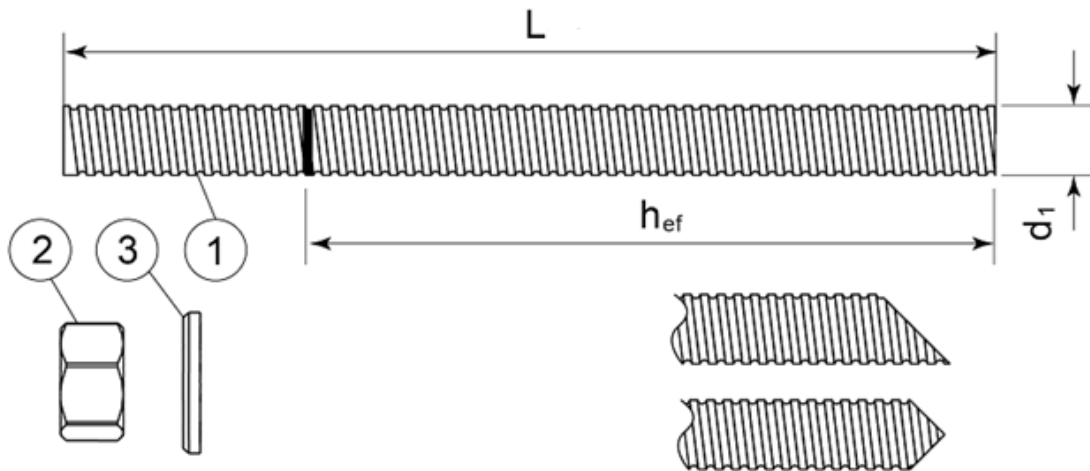

Standard commercial threaded rod with marked embedment depth

| Part | Designation | Material |
|---|--|---|
| Steel, zinc plated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042 or Steel, Hot-dip galvanized $\geq 40 \mu\text{m}$ acc. to EN ISO 1461 and EN ISO 10684 or Steel, zinc diffusion coating $\geq 15 \mu\text{m}$ acc. to EN 13811 | | |
| 1 | Anchor rod | Steel, EN 10087 or EN 10263 Property class 4.6, 5.8, 8.8, 10.9* EN ISO 898-1 |
| 2 | Hexagon nut EN ISO 4032 | According to threaded rod, EN 20898-2 |
| 3 | Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094 | According to threaded rod |
| Stainless steel | | |
| 1 | Anchor rod | Material: A2-70, A4-70, A4-80, EN ISO 3506 |
| 2 | Hexagon nut EN ISO 4032 | According to threaded rod |
| 3 | Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094 | According to threaded rod |
| High corrosion resistant steel | | |
| 1 | Anchor rod | Material: 1.4529, 1.4565, EN 10088-1 |
| 2 | Hexagon nut EN ISO 4032 | According to threaded rod |
| 3 | Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094 | According to threaded rod |

*Galvanized rod of high strength are sensitive to hydrogen induced brittle failure

MOPUR3

Product description
Threaded rod and materials

Annex A 3

Rebar Ø8, Ø10, Ø12, Ø16, Ø20, Ø25, Ø32



Standard commercial reinforcing bar with marked embedment depth

| Product form | | Bars and de-coiled rods | |
|--|-----------------------|-------------------------|-----------------------|
| Class | | B | C |
| Characteristic yield strength f_{yk} or $f_{0,2k}$ (MPa) | | 400 to 600 | |
| Minimum value of $k = (f_t/f_y)_k$ | | $\geq 1,08$ | $\geq 1,15$ < 1,35 |
| Characteristic strain at maximum force ϵ_{uk} (%) | | $\geq 5,0$ | $\geq 7,5$ |
| Bendability | | Bend/Rebend test | |
| Maximum deviation from nominal mass (individual bar) (%) | Nominal bar size (mm) | $\pm 6,0$ $\pm 4,5$ | |
| | ≤ 8 > 8 | | |
| Bond: Minimum relative rib area, $f_{R,min}$ | Nominal bar size (mm) | 0,040 0,056 | |
| | 8 to 12 > 12 | | |

MOPUR3

Product description
Rebars and materials

Annex A 4

Specifications of intended use

Anchorage subject to:

- Static and quasi-static load
- Seismic actions category C1 (max w = 0,5 mm):
 - threaded rod size M8, M10, M12, M16, M20, M24, M27, M30
 - rebar size Ø10, Ø12, Ø16, Ø20, Ø25, Ø32
- Seismic actions category C2 (max w = 0,8 mm): threaded rod size M12, M16, M20

Base materials

- Cracked and uncracked concrete
- Reinforced or unreinforced normal weight concrete of strength class C20/25 at minimum and C50/60 at maximum according EN 206:2013.

Temperature range:

- T3: -40°C to +70°C (max. short. term temperature +70°C and max. long term temperature +50°C)

Use conditions (Environmental conditions)

- (X1) Structures subject to dry internal conditions (zinc coated steel, stainless steel, high corrosion resistance steel).
- (X2) Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel A4, high corrosion resistant steel).
- (X3) Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel).

Note: *Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).*

Concrete conditions:

- I1 – installation in dry or wet (water saturated) concrete and use in service in dry or wet concrete.
- I2 – installation in water-filled (not sea water) and use in service in dry or wet concrete

Design:

- The anchorages are designed in accordance with the EN 1992-4 under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings.
- Anchorages under seismic actions (cracked concrete) have to be designed in accordance with EN 1992-4.

Installation:

- Hole drilling by hammer drill mode.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

Installation direction:

- D3 – downward and horizontal and upwards (e.g. overhead) installation

MOPUR3

Intended use
Specifications

Annex B 1

Applicator gun

A




B



C



D

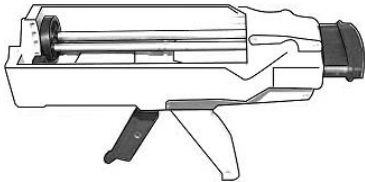

E




| Applicator gun | A | B | C | D | E |
|----------------|------------------------|------------------------|------------------------|------------------------|------------------------|
| Cartridge | Side by side 385 ml | Side by side 385 ml | Side by side 385 ml | Side by side 585 ml | Foil capsule 300 ml |

Cleaning steel brush



Brush extensions

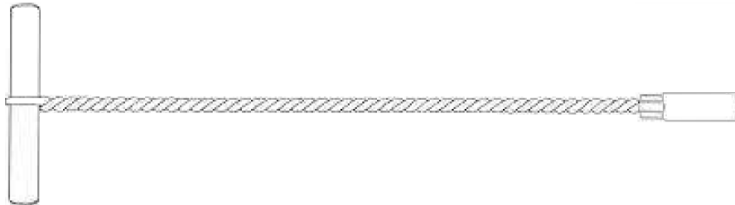

MOPUR3


Intended use
Applicator guns
Cleaning brush

Annex B 2


Installation instructions

Before commencing installation ensure the operative is equipped with appropriate personal protection equipment, SDS Hammer Drill, Air, Hole Cleaning Brush, good quality Dispensing Tool – either manual or power operated, Chemical cartridge with mixing nozzle and extension tube, if needed.

- Using the SDS Hammer Drill in rotary hammer mode for drilling, with a carbide tipped drill bit of the appropriate size, drill the hole to the specified hole diameter and depth.




- Insert the Air Lance to the bottom of the hole and depress the trigger for 2 seconds. The compressed air must be clean – free from water and oil – and at a minimum pressure of 6bar.



Perform the blowing operation twice.

- Select the correct size Hole Cleaning Brush. Ensure that the brush is in good condition and the correct diameter. Insert the brush to the bottom of the hole, using a brush




extension if needed to reach the bottom of the hole and withdraw with a twisting motion. *There should be positive interaction between the steel bristles of the brush and the sides of the drilled hole.*

Perform the brushing operation twice.


- Repeat 2
- Repeat 3
- Repeat 2

- Select the appropriate static mixer nozzle, checking that the mixing elements are present and correct (**do not modify the mixer**). Attach mixer nozzle to the cartridge. Check the Dispensing Tool is in good working order. Place the cartridge into the dispensing tool.


Note: The QH nozzle is in two sections. One section contains the mixing elements and the other section is an extension piece. Connect the extension piece to the mixing section by pushing the two sections firmly together until a positive engagement is felt.

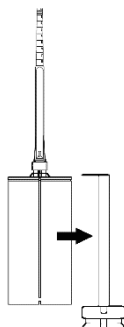

- Extrude some resin to waste until an even-colored mixture is extruded. The cartridge is now ready for use




- Attach an extension tube with resin stopper (if required) to the end of the mixing nozzle with a push fit



(The extension tubes may be pushed into the resin stoppers and are held in place with a coarse internal thread).

- Insert the mixing nozzle to the bottom of the hole. Extrude the resin and slowly withdraw the nozzle from the hole. **Ensure no air voids are created** as the nozzle is withdrawn. Inject resin until the hole is approximately $\frac{3}{4}$ full and remove the nozzle from the hole.




- Select the steel anchor element ensuring it is free from oil or other contaminants, and mark with the required embedment depth. Insert the steel element into the hole using a back and forth twisting motion to ensure complete cover, until it reaches the bottom of the hole. Excess resin will be expelled from the hole evenly around the steel element and there shall be no gaps between the anchor element and the wall of the drilled hole.




- Clean any excess resin from around the mouth of the hole.

- Do not disturb the anchor until at least the minimum cure time has elapsed. Refer to the Working and Load Timetable to determine the appropriate cure time.



- Position the fixture and tighten the anchor to the appropriate installation torque.



Do not over-torque the anchor as this could adversely affect its performance.

MOPUR3


Intended use
Installation procedure

Annex B 3


Installation instructions

Overhead Substrate Installation Method

1. Using the SDS Hammer Drill in rotary hammer mode for drilling, with a carbide tipped drill bit of the appropriate size, drill the hole to the specified hole diameter and depth.




2. Select the correct Air Lance, insert to the bottom of the hole and depress the trigger for 2 seconds. The compressed air must be clean – free from water and oil – and at a minimum pressure of 90psi (6bar).



Perform the blowing operation twice.

3. Select the correct size Hole Cleaning Brush. Ensure that the brush is in good condition and the correct diameter. Insert the brush to the bottom of the hole, using a brush extension if needed to reach the bottom of the hole, and withdraw with a twisting motion. *There should be positive interaction between the steel bristles of the brush and the sides of the drilled hole.*



Perform the brushing operation twice.

- 4. Repeat 2
- 5. Repeat 3
- 6. Repeat 2
- 7. Select the appropriate static mixer nozzle checking that the mixing elements are present and correct (**do not modify the mixer**). Attach mixer nozzle to the cartridge. Check the Dispensing Tool is in good working order. Place the cartridge into the dispensing tool.




Note: The QH nozzle is in two sections. One section contains the mixing elements and the other section is an extension piece. Connect the extension piece to the mixing section by pushing the two sections firmly together until a positive engagement is felt.

8. Extrude some resin to waste until an even-colored mixture is extruded, The cartridge is now ready for use.



9. Attach an extension tube with resin stopper (if required) to the end of the mixing nozzle with a push fit. (The extension tubes may be pushed into the resin stoppers and are held in place with a coarse internal thread).



10. Insert the mixing nozzle to the bottom of the hole. Extrude the resin and slowly withdraw the nozzle from the hole. **Ensure no air voids are created** as the nozzle is withdrawn. Inject resin until the hole is approximately ¾ full and remove the nozzle from the hole.



11. Select the steel anchor element ensuring it is free from oil or other contaminants, and mark with the required embedment depth. Insert the steel element into the hole using a back and forth twisting motion to ensure complete cover, until it reaches the bottom of the hole.



Excess resin will be expelled from the hole evenly around the steel element and there shall be no gaps between the anchor element and the wall of the drilled hole.

12. Clean any excess resin from around the mouth of the hole.

13. Do not disturb the anchor until at least the minimum cure time has elapsed. Refer to the Working and Load Timetable to determine the appropriate cure time.



14. Position the fixture and tighten the anchor to the appropriate installation torque.



Do not over-torque the anchor as this could adversely affect its performance.

MOPUR3

Intended use
Installation procedure

Annex B 4

Table B1: Installation parameters of threaded rod

| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|----------------------------------|------------------------|--|------------|------------|-----------------|------------|------------|------------|------------|
| Nominal drill hole diameter | $\varnothing d_0$ [mm] | 10 | 12 | 14 | 18 | 22 | 26 | 30 | 35 |
| Cleaning brush | | S11HF | S14HF | S14/15HF | S22HF | S24HF | S31HF | S31HF | S38HF |
| Torque moment | $\max T_{fixt}$ [Nm] | 10 | 20 | 40 | 80 | 120 | 160 | 180 | 200 |
| Embedment depth for $h_{ef,min}$ | h_{ef} [mm] | 60 | 60 | 70 | 80 | 90 | 96 | 108 | 120 |
| Embedment depth for $h_{ef,max}$ | h_{ef} [mm] | 160 | 200 | 240 | 320 | 400 | 480 | 540 | 600 |
| Depth of drill hole | h_0 [mm] | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ |
| Minimum edge distance | c_{min} [mm] | 40 | 40 | 40 | 40 | 50 | 50 | 50 | 60 |
| Minimum spacing | s_{min} [mm] | 40 | 40 | 40 | 40 | 50 | 50 | 50 | 60 |
| Minimum thickness of member | h_{min} [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{ef} + 2d_0$ | | | | |

Table B2: Installation parameters of rebar

| Size | | $\varnothing 8$ | $\varnothing 10$ | $\varnothing 12$ | $\varnothing 16$ | $\varnothing 20$ | $\varnothing 25$ | $\varnothing 32$ |
|----------------------------------|------------------------|--|------------------|------------------|------------------|------------------|------------------|------------------|
| Nominal drill hole diameter | $\varnothing d_0$ [mm] | 12 | 14 | 16 | 20 | 25 | 32 | 40 |
| Cleaning brush | | S12/13HF | S14/15HF | S18HF | S22HF | S27HF | S35HF | S43HF |
| Torque moment | $\max T_{fixt}$ [Nm] | 10 | 20 | 40 | 80 | 120 | 180 | 200 |
| Embedment depth for $h_{ef,min}$ | h_{ef} [mm] | 60 | 60 | 70 | 80 | 90 | 100 | 128 |
| Embedment depth for $h_{ef,max}$ | h_{ef} [mm] | 160 | 200 | 240 | 320 | 400 | 500 | 640 |
| Depth of drill hole | h_0 [mm] | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ | $h_{ef}+5$ |
| Minimum edge distance | c_{min} [mm] | 40 | 40 | 40 | 40 | 50 | 50 | 70 |
| Minimum spacing | s_{min} [mm] | 40 | 40 | 40 | 40 | 50 | 50 | 70 |
| Minimum thickness of member | h_{min} [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | $h_{ef} + 2d_0$ | | | |

Table B3: Minimum curing time

| Base Material Temperature [°C] | Cartridge Temperature [°C] | T Work [mins] | T Load [hrs] |
|---|----------------------------|---------------|--------------|
| +5 | Minimum +10 | 300 | 24 |
| +5°C to +10 | | 150 | |
| +10°C to +15 | +10°C to +15 | 40 | 18 |
| +15°C to +20 | +15°C to +20 | 25 | 12 |
| +20°C to +25 | +20°C to +25 | 18 | 8 |
| +25°C to +30 | +25°C to +30 | 12 | 6 |
| +30°C to +35 | +30°C to +35 | 8 | 4 |
| +35°C to +40 | +35°C to +40 | 6 | 2 |
| Ensure cartridge is $\geq 10^\circ\text{C}$ | | | |

T Work is typical gel time at highest base material temperature in the range.

T Load is minimum set time required until load can be applied at the lowest temperature in the range.

MOPUR3

Intended use
Installation parameters
Curing time

Annex B 5

Table C1: Design method EN 1992-4

Characteristic values of resistance to tension load of threaded rod

| Steel failure – Characteristic resistance | | | | | | | | | | |
|--|-----------------|----------------------|-----------------|------------|------------|------------|------------|------------|------------|------------|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Steel grade 4.6 | $N_{Rk,s}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} | [-] | 2,00 | | | | | | | |
| Steel grade 5.8 | $N_{Rk,s}$ | [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Steel grade 8.8 | $N_{Rk,s}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Steel grade 10.9 | $N_{Rk,s}$ | [kN] | 37 | 58 | 84 | 157 | 245 | 353 | 459 | 561 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | | | |
| Stainless steel grade A2-70, A4-70 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | |
| Stainless steel grade A4-80 | $N_{Rk,s}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 |
| Partial safety factor | γ_{Ms} | [-] | 1,60 | | | | | | | |
| Stainless steel grade 1.4529 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Stainless steel grade 1.4565 | $N_{Rk,s}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | |
| Combined pullout and concrete cone failure in concrete C20/25 | | | | | | | | | | |
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Characteristic bond resistance in uncracked concrete | | | | | | | | | | |
| Temperature T3: -40°C to +70°C | $\tau_{Rk,ucr}$ | [N/mm ²] | 14 | 13 | 13 | 12 | 12 | 11 | 10 | 9 |
| Dry, wet concrete, flooded hole | | | | | | | | | | |
| Partial safety factor | γ_{inst} | [-] | 1,0 | | | | | | | |
| Factor for uncracked concrete | C25/30 | ψ_c | [-] | 1,02 | | | | | | |
| | C30/37 | | | 1,04 | | | | | | |
| | C35/45 | | | 1,06 | | | | | | |
| | C40/50 | | | 1,07 | | | | | | |
| | C45/55 | | | 1,08 | | | | | | |
| | C50/60 | | | 1,09 | | | | | | |
| Characteristic bond resistance in cracked concrete | | | | | | | | | | |
| Temperature T3: -40°C to +70°C | $\tau_{Rk,cr}$ | [N/mm ²] | 8 | 8 | 7,5 | 7,5 | 7 | 7 | 5 | 5 |
| Dry, wet concrete, flooded hole | | | | | | | | | | |
| Partial safety factor | γ_{inst} | [-] | 1,0 | | | | | | | |
| Factor for cracked concrete | C25/30 | ψ_c | [-] | 1,02 | | | | | | |
| | C30/37 | | | 1,04 | | | | | | |
| | C35/45 | | | 1,06 | | | | | | |
| | C40/50 | | | 1,07 | | | | | | |
| | C45/55 | | | 1,08 | | | | | | |
| | C50/60 | | | 1,09 | | | | | | |
| Concrete cone failure | | | | | | | | | | |
| Factor for concrete cone failure for uncracked concrete | $k_{ucr,N}$ | [-] | 11 | | | | | | | |
| Factor for concrete cone failure for cracked concrete | $k_{cr,N}$ | | 7,7 | | | | | | | |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} | | | | | | | |
| Splitting failure | | | | | | | | | | |
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Edge distance | $c_{cr,sp}$ | [mm] | 2 • h_{ef} | | | | | | | |
| Spacing | $s_{cr,sp}$ | [mm] | 2 • $c_{cr,sp}$ | | | | | | | |

MOPUR3

Performances

Design according to EN 1992-4

Characteristic resistance for tension loads - threaded rod

Annex C 1

Table C2: Design method EN 1992-4
Characteristic values of resistance to tension load of rebar

| Steel failure – Characteristic resistance | | | | | | | | | | |
|---|---------------|------|-----|-----|-----|-----|-----|-----|-----|--|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 | |
| Rebar BSt 500 S | $N_{Rk,s}$ | [kN] | 28 | 43 | 62 | 111 | 173 | 270 | 442 | |
| Partial safety factor | γ_{Ms} | [-] | 1,4 | | | | | | | |

| Pullout failure in concrete C20/25 | | | | | | | | | | |
|---|-----------------|----------------------|-----|------|-----|-----|-----|-----|------|--|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 | |
| Characteristic bond resistance in uncracked concrete | | | | | | | | | | |
| Temperature T3: -40°C to +70°C | $\tau_{Rk,ucr}$ | [N/mm ²] | 12 | 12 | 12 | 11 | 11 | 11 | 7 | |
| Dry and wet concrete | | | | | | | | | | |
| Installation safety factor | γ_{inst} | [-] | 1,0 | | | | | | | |
| Flooded hole | | | | | | | | | | |
| Installation safety factor | γ_{inst} | [-] | 1,2 | | | | | | | |
| Factor for uncracked concrete | C25/30 | ψ_c | [-] | | | | | | 1,02 | |
| | C30/37 | | | 1,04 | | | | | | |
| | C35/45 | | | 1,06 | | | | | | |
| | C40/50 | | | 1,07 | | | | | | |
| | C45/55 | | | 1,08 | | | | | | |
| C50/60 | 1,09 | | | | | | | | | |
| Characteristic bond resistance in cracked concrete | | | | | | | | | | |
| Temperature T3: -40°C to +70°C | $\tau_{Rk,cr}$ | [N/mm ²] | 7 | 10 | 9 | 9 | 8 | 8 | 5 | |
| Dry and wet concrete | | | | | | | | | | |
| Installation safety factor | γ_{inst} | [-] | 1,0 | | | | | | | |
| Flooded hole | | | | | | | | | | |
| Installation safety factor | γ_{inst} | [-] | 1,2 | | | | | | | |
| Factor for cracked concrete | C25/30 | ψ_c | [-] | | | | | | 1,02 | |
| | C30/37 | | | 1,04 | | | | | | |
| | C35/45 | | | 1,06 | | | | | | |
| | C40/50 | | | 1,07 | | | | | | |
| | C45/55 | | | 1,08 | | | | | | |
| C50/60 | 1,09 | | | | | | | | | |

| Concrete cone failure | | | |
|---|-----------------------------------|------|--------------|
| Factor for concrete cone failure for uncracked concrete | $\frac{k_1^{1)}}{k_{ucr,N}^{2)}}$ | [-] | 10,1 |
| Factor for concrete cone failure for cracked concrete | $\frac{k_1^{1)}}{k_{cr,N}^{2)}}$ | | 7,2 |
| Edge distance | $c_{cr,N}$ | [mm] | 1,5 h_{ef} |

| Splitting failure | | | | | | | | | |
|-------------------|-------------|------|-----------------|-----|-----|-----|-----|-----|-----|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
| Edge distance | $c_{cr,sp}$ | [mm] | 2 • h_{ef} | | | | | | |
| Spacing | $s_{cr,sp}$ | [mm] | 2 • $c_{cr,sp}$ | | | | | | |

MOPUR3

Performances

Design according to EN 1992-4
Characteristic resistance for tension loads - rebar

Annex C 2

Table C3: Design method EN 1992-4
Characteristic values of resistance to shear load of threaded rod

| Steel failure without lever arm | | | | | | | | | | |
|--|---------------|------|------|-----|-----|-----|-----|-----|-----|-----|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Steel grade 4.6 | $V_{Rk,s}$ | [kN] | 7 | 12 | 17 | 31 | 49 | 71 | 92 | 112 |
| Partial safety factor | γ_{Ms} | [-] | 1,67 | | | | | | | |
| Steel grade 5.8 | $V_{Rk,s}$ | [kN] | 9 | 15 | 21 | 39 | 61 | 88 | 115 | 140 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Steel grade 8.8 | $V_{Rk,s}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Steel grade 10.9 | $V_{Rk,s}$ | [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 |
| Partial safety factor | γ_{Ms} | [-] | 1,5 | | | | | | | |
| Stainless steel grade A2-70, A4-70 | $V_{Rk,s}$ | [kN] | 13 | 20 | 30 | 55 | 86 | 124 | 161 | 196 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | | | |
| Stainless steel grade A4-80 | $V_{Rk,s}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | | | |
| Stainless steel grade 1.4529 | $V_{Rk,s}$ | [kN] | 13 | 20 | 30 | 55 | 86 | 124 | 161 | 196 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Stainless steel grade 1.4565 | $V_{Rk,s}$ | [kN] | 13 | 20 | 30 | 55 | 86 | 124 | 161 | 196 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | | | |
| Characteristic resistance of group of fasteners | | | | | | | | | | |
| Ductility factor $k_7 = 1,0$ for steel with rupture elongation $A_5 > 8\%$ | | | | | | | | | | |

| Steel failure with lever arm | | | | | | | | | | |
|--|---------------|-------|------|-----|-----|-----|-----|------|------|------|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Steel grade 4.6 | $M_{Rk,s}^o$ | [N.m] | 15 | 30 | 52 | 133 | 260 | 449 | 666 | 900 |
| Partial safety factor | γ_{Ms} | [-] | 1,67 | | | | | | | |
| Steel grade 5.8 | $M_{Rk,s}^o$ | [N.m] | 19 | 37 | 66 | 166 | 325 | 561 | 832 | 1125 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Steel grade 8.8 | $M_{Rk,s}^o$ | [N.m] | 30 | 60 | 105 | 266 | 519 | 898 | 1332 | 1799 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Steel grade 10.9 | $M_{Rk,s}^o$ | [N.m] | 37 | 75 | 131 | 333 | 649 | 1123 | 1664 | 2249 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Stainless steel grade A2-70, A4-70 | $M_{Rk,s}^o$ | [N.m] | 26 | 52 | 92 | 233 | 454 | 786 | 1165 | 1574 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | | | |
| Stainless steel grade A4-80 | $M_{Rk,s}^o$ | [N.m] | 30 | 60 | 105 | 266 | 519 | 898 | 1332 | 1799 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | | | |
| Stainless steel grade 1.4529 | $M_{Rk,s}^o$ | [N.m] | 26 | 52 | 92 | 233 | 454 | 786 | 1165 | 1574 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Stainless steel grade 1.4565 | $M_{Rk,s}^o$ | [N.m] | 26 | 52 | 92 | 233 | 454 | 786 | 1165 | 1574 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | | | |
| Concrete pryout failure | | | | | | | | | | |
| Factor for resistance to pry-out failure | k_8 | [-] | 2 | | | | | | | |

| Concrete edge failure | | | | | | | | | | |
|------------------------------|-----------|------|--------------------------------|-----|-----|-----|-----|-----|-----|-----|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
| Outside diameter of fastener | d_{nom} | [mm] | 8 | 10 | 12 | 16 | 20 | 24 | 27 | 30 |
| Effective length of fastener | l_f | [mm] | min (h_{ef} , 8 d_{nom}) | | | | | | | |

MOPUR3

Performances

Design according to EN 1992-4
Characteristic resistance for shear loads - threaded rod

Annex C 3

Table C4: Design method EN 1992-4
Characteristic values of resistance to shear load of rebar

| Steel failure without lever arm | | | | | | | | | | |
|--|---|------|-----|-----|-----|-----|-----|-----|-----|--|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 | |
| Rebar BSt 500 S | $V_{Rk,S}$ | [kN] | 14 | 22 | 31 | 55 | 86 | 135 | 221 | |
| Partial safety factor | γ_{Ms} | [-] | 1,5 | | | | | | | |
| Characteristic resistance of group of fasteners | | | | | | | | | | |
| Ductility factor | $k_7 = 1,0$ for steel with rupture elongation $A_5 > 8\%$ | | | | | | | | | |

| Steel failure with lever arm | | | | | | | | | | |
|--|---------------|-------|-----|-----|-----|-----|-----|------|------|--|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 | |
| Rebar BSt 500 S | $M_{Rk,S}^o$ | [N.m] | 33 | 65 | 112 | 265 | 518 | 1013 | 2122 | |
| Partial safety factor | γ_{Ms} | [-] | 1,5 | | | | | | | |
| Concrete pryout failure | | | | | | | | | | |
| Factor for resistance to pry-out failure | k_8 | [-] | 2 | | | | | | | |

| Concrete edge failure | | | | | | | | | | |
|------------------------------|-----------|------|-----------------------------|-----|-----|-----|-----|-----|-----|--|
| Size | | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 | |
| Outside diameter of fastener | d_{nom} | [mm] | 8 | 10 | 12 | 16 | 20 | 25 | 32 | |
| Effective length of fastener | l_f | [mm] | min ($h_{ef}, 8 d_{nom}$) | | | | | | | |

MOPUR3

Performances

Design according to EN 1992-4
Characteristic resistance for shear loads - rebar

Annex C 4

Table C5: Displacement of threaded rod under tension and shear load

| Size | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|--------------------|------|------|------|------|------|------|------|------|------|
| Tension load | | | | | | | | | |
| Uncracked concrete | | | | | | | | | |
| F | [kN] | 11,9 | 14,3 | 19,0 | 23,8 | 35,7 | 35,7 | 45,2 | 45,2 |
| δ_{N0} | [mm] | 0,3 | 0,3 | 0,3 | 0,4 | 0,4 | 0,5 | 0,5 | 0,5 |
| $\delta_{N\infty}$ | [mm] | 0,6 | 0,6 | 0,6 | 0,6 | 0,6 | 0,6 | 0,6 | 0,6 |
| Cracked concrete | | | | | | | | | |
| F | [kN] | 5,7 | 9,5 | 14,3 | 16,7 | 23,8 | 28,6 | 28,6 | 28,6 |
| δ_{N0} | [mm] | 0,3 | 0,4 | 0,4 | 0,5 | 0,5 | 0,6 | 0,6 | 0,7 |
| $\delta_{N\infty}$ | [mm] | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 |
| Shear load | | | | | | | | | |
| F | [kN] | 3,5 | 5,5 | 8,0 | 15,0 | 23,3 | 33,6 | 43,7 | 53,4 |
| δ_{V0} | [mm] | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 |
| $\delta_{V\infty}$ | [mm] | 3,7 | 3,7 | 3,7 | 3,7 | 3,7 | 3,7 | 3,7 | 3,7 |

Table C6: Displacement of rebar under tension and shear load

| Size | | Ø8 | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
|--------------------|------|-----|------|------|------|------|------|-------|
| Tension load | | | | | | | | |
| Uncracked concrete | | | | | | | | |
| F | [kN] | 7,6 | 11,9 | 16,7 | 28,6 | 35,7 | 45,2 | 66,7 |
| δ_{N0} | [mm] | 0,3 | 0,3 | 0,4 | 0,4 | 0,4 | 0,5 | 0,5 |
| $\delta_{N\infty}$ | [mm] | 0,6 | 0,6 | 0,6 | 0,6 | 0,6 | 0,6 | 0,6 |
| Cracked concrete | | | | | | | | |
| F | [kN] | 5,7 | 9,5 | 11,9 | 19,0 | 23,8 | 28,6 | 35,7 |
| δ_{N0} | [mm] | 0,3 | 0,4 | 0,4 | 0,5 | 0,5 | 0,5 | 0,6 |
| $\delta_{N\infty}$ | [mm] | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 | 2,0 |
| Shear load | | | | | | | | |
| F | [kN] | 6,6 | 10,3 | 14,8 | 26,3 | 41,1 | 64,3 | 105,3 |
| δ_{V0} | [mm] | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 | 2,5 |
| $\delta_{V\infty}$ | [mm] | 3,7 | 3,7 | 3,7 | 3,7 | 3,7 | 3,7 | 3,7 |

MOPUR3

Performances
Displacement for threaded rod and rebar

Annex C 5

Table C7: Seismic performance category C1 of threaded rod

| Size | | | M8 | M10 | M12 | M16 | M20 | M24 | M27 | M30 |
|---|----------------------|----------------------|------|------|------|------|------|------|------|------|
| Tension load | | | | | | | | | | |
| Steel failure | | | | | | | | | | |
| Characteristic resistance grade 4.6 | $N_{Rk,s,eq,C1}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 | 184 | 224 |
| Partial safety factor | γ_{Ms} | [-] | 2,00 | | | | | | | |
| Characteristic resistance grade 5.8 | $N_{Rk,s,eq,C1}$ | [kN] | 18 | 29 | 42 | 79 | 123 | 177 | 230 | 281 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Characteristic resistance grade 8.8 | $N_{Rk,s,eq,C1}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Characteristic resistance grade 10.9 | $N_{Rk,s,eq,C1}$ | [kN] | 37 | 58 | 84 | 157 | 245 | 353 | 459 | 561 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | | | |
| Characteristic resistance A2-70, A4-70 | $N_{Rk,s,eq,C1}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | |
| Characteristic resistance A4-80 | $N_{Rk,s,eq,C1}$ | [kN] | 29 | 46 | 67 | 126 | 196 | 282 | 367 | 449 |
| Partial safety factor | γ_{Ms} | [-] | 1,60 | | | | | | | |
| Characteristic resistance 1.4529 | $N_{Rk,s,eq,C1}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Characteristic resistance 1.4565 | $N_{Rk,s,eq,C1}$ | [kN] | 26 | 41 | 59 | 110 | 172 | 247 | 321 | 393 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | | | | | | |
| Characteristic resistance to pull-out | | | | | | | | | | |
| Temperature T3: -40°C to +70°C | $\tau_{Rk,p,eq,C1}$ | [N/mm ²] | 8,0 | 8,0 | 7,5 | 7,5 | 7,0 | 7,0 | 5,0 | 4,5 |
| Installation safety factor | γ_{inst} | [-] | 1,0 | | | | | | | |
| Shear load | | | | | | | | | | |
| Steel failure without lever arm | | | | | | | | | | |
| Characteristic resistance grade 4.6 | $V_{Rk,s,eq,C1}$ | [kN] | 5 | 9 | 13 | 20 | 32 | 28 | 37 | 45 |
| Partial safety factor | γ_{Ms} | [-] | 1,67 | | | | | | | |
| Characteristic resistance grade 5.8 | $V_{Rk,s,eq,C1}$ | [kN] | 7 | 11 | 16 | 26 | 40 | 35 | 46 | 56 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Characteristic resistance grade 8.8 | $V_{Rk,s,eq,C1}$ | [kN] | 11 | 17 | 25 | 41 | 64 | 56 | 73 | 90 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Characteristic resistance grade 10.9 | $V_{Rk,s,eq,C1}$ | [kN] | 14 | 22 | 32 | 51 | 80 | 71 | 92 | 112 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | | | |
| Characteristic resistance A2-70, A4-70 | $V_{Rk,s,eq,C1}$ | [kN] | 10 | 15 | 22 | 36 | 56 | 49 | 64 | 79 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | | | |
| Characteristic resistance A4-80 | $V_{Rk,s,eq,C1}$ | [kN] | 11 | 17 | 25 | 41 | 64 | 56 | 73 | 90 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | | | |
| Characteristic resistance 1.4529 | $V_{Rk,s,eq,C1}$ | [kN] | 10 | 15 | 22 | 36 | 56 | 49 | 54 | 79 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | | | |
| Characteristic resistance 1.4565 | $V_{Rk,s,eq,C1}$ | [kN] | 10 | 15 | 22 | 36 | 56 | 49 | 54 | 79 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | | | |
| Characteristic shear load resistance $V_{Rk,s,eq}$ in the Table C7 shall be multiplied by following reduction factor for hot-dip galvanized commercial standard rods | | | | | | | | | | |
| Reduction factor for hot-dip galvanized rods | $\alpha_{v,h-dg,c1}$ | [-] | 0,47 | 0,47 | 0,47 | 0,54 | 0,54 | 0,88 | 0,88 | 0,88 |
| Factor for annular gap | α_{gap} | [-] | 0,5 | | | | | | | |

The anchor shall be used with minimum rupture elongation after fracture A_5 equal to 19%.

MOPUR3

Performances
Seismic performance category C1 of threaded rod

Annex C 6

Table C8: Seismic performance category C1 of rebar

| Size | | | Ø10 | Ø12 | Ø16 | Ø20 | Ø25 | Ø32 |
|--|---------------------|----------------------|-----|-----|-----|-----|-----|-----|
| Tension load | | | | | | | | |
| Steel failure | | | | | | | | |
| Rebar BSt 500 S | $N_{Rk,s,eq,C1}$ | [kN] | 43 | 62 | 111 | 173 | 270 | 442 |
| Partial safety factor | γ_{Ms} | [-] | 1,4 | | | | | |
| Characteristic resistance to pull-out | | | | | | | | |
| Temperature T3: -40°C to +70°C | $\tau_{Rk,p,eq,C1}$ | [N/mm ²] | 8,9 | 9,0 | 9,0 | 8,0 | 7,5 | 4,8 |
| Dry and wet concrete | | | | | | | | |
| Installation safety factor | γ_{inst} | [-] | 1,0 | | | | | |
| Flooded hole | | | | | | | | |
| Installation safety factor | γ_{inst} | [-] | 1,2 | | | | | |
| Shear load | | | | | | | | |
| Steel failure without lever arm | | | | | | | | |
| Rebar BSt 500 S | $V_{Rk,s,eq,C1}$ | [kN] | 16 | 23 | 41 | 69 | 67 | 111 |
| Partial safety factor | γ_{Ms} | [-] | 1,5 | | | | | |
| Factor for annular gap | α_{gap} | [-] | 0,5 | | | | | |

MOPUR3

Performances
Seismic performance category C1 of rebar

Annex C 7

Table C9: Seismic performance category C2 of threaded rod

| Size | | | M12 | M16 | M20 |
|---|----------------------|----------------------|------|------|------|
| Tension load | | | | | |
| Steel failure | | | | | |
| Characteristic resistance grade 4.6 | $N_{Rk,s,eq,C2}$ | [kN] | 34 | 63 | 98 |
| Partial safety factor | γ_{Ms} | [-] | 2,00 | | |
| Characteristic resistance grade 5.8 | $N_{Rk,s,eq,C2}$ | [kN] | 42 | 79 | 123 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | |
| Characteristic resistance grade 8.8 | $N_{Rk,s,eq,C2}$ | [kN] | 67 | 126 | 196 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | |
| Characteristic resistance grade 10.9 | $N_{Rk,s,eq,C2}$ | [kN] | 84 | 157 | 245 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | |
| Characteristic resistance A2-70, A4-70 | $N_{Rk,s,eq,C2}$ | [kN] | 59 | 110 | 172 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | |
| Characteristic resistance A4-80 | $N_{Rk,s,eq,C2}$ | [kN] | 67 | 126 | 196 |
| Partial safety factor | γ_{Ms} | [-] | 1,60 | | |
| Characteristic resistance 1.4529 | $N_{Rk,s,eq,C2}$ | [kN] | 59 | 110 | 172 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | |
| Characteristic resistance 1.4565 | $N_{Rk,s,eq,C2}$ | [kN] | 59 | 110 | 172 |
| Partial safety factor | γ_{Ms} | [-] | 1,87 | | |
| Characteristic resistance to pull-out | | | | | |
| Temperature T3: -40°C to +70°C | $\tau_{Rk,p,eq,C2}$ | [N/mm ²] | 3,2 | 3,7 | 4,2 |
| Installation safety factor | γ_{inst} | [-] | 1,0 | | |
| Shear load | | | | | |
| Steel failure without lever arm | | | | | |
| Characteristic resistance grade 4.6 | $V_{Rk,s,eq,C2}$ | [kN] | 13 | 18 | 28 |
| Partial safety factor | γ_{Ms} | [-] | 1,67 | | |
| Characteristic resistance grade 5.8 | $V_{Rk,s,eq,C2}$ | [kN] | 16 | 22 | 35 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | |
| Characteristic resistance grade 8.8 | $V_{Rk,s,eq,C2}$ | [kN] | 25 | 36 | 56 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | |
| Characteristic resistance grade 10.9 | $V_{Rk,s,eq,C2}$ | [kN] | 32 | 45 | 70 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | |
| Characteristic resistance A2-70, A4-70 | $V_{Rk,s,eq,C2}$ | [kN] | 22 | 31 | 49 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | |
| Characteristic resistance A4-80 | $V_{Rk,s,eq,C2}$ | [kN] | 25 | 36 | 56 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | |
| Characteristic resistance 1.4529 | $V_{Rk,s,eq,C2}$ | [kN] | 22 | 31 | 49 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | |
| Characteristic resistance 1.4565 | $V_{Rk,s,eq,C2}$ | [kN] | 22 | 31 | 49 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | |
| Characteristic shear load resistance $V_{Rk,s,eq}$ in the Table C9 shall be multiplied by following reduction factor for hot-dip galvanized commercial standard rods | | | | | |
| Reduction factor for hot-dip galvanized rods | $\alpha_{v,h-dg,c2}$ | [-] | 0,46 | 0,61 | 0,61 |
| Factor for annular gap | α_{gap} | [-] | 0,5 | | |

Table C10: Displacement under tensile and shear load - seismic category C2 of threaded rod

| Size | | M12 | M16 | M20 |
|----------------------|------|-------|------|-------|
| $\delta_{N,eq}(DLS)$ | [mm] | 0,20 | 0,40 | 0,77 |
| $\delta_{N,eq}(ULS)$ | [mm] | 0,76 | 0,74 | 1,68 |
| $\delta_{V,eq}(DLS)$ | [mm] | 5,29 | 4,12 | 4,94 |
| $\delta_{V,eq}(ULS)$ | [mm] | 10,20 | 90,5 | 10,99 |

The anchor shall be used with minimum rupture elongation after fracture A_5 equal to 19%.

MOPUR3

Performances
Seismic performance category C2 of threaded rod

Annex C 8